



# Test Report: NSP-1000-27

---

1000W AC/DC High Reliable Multi-Industrial Enclosed Type Power Supply

## ■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Control Function Test

Component Stress Test

## ■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

## ■ RELIABILITY TEST


ENVIRONMENT TEST

■ DESIGN VERIFY TEST


**OUTPUT FUNCTION TEST**

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1:24.3V~32.4V	I/P : 230 VAC O/P : MIN LOAD Ta : 25°C	23.67V~33.2V/230VAC
2	OUTPUT VOLTAGE TOLERANCE	V1: -1%~ 1%	I/P: 85VAC /305VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1: - 0.0004 %~0.1481%
3	LINE REGULATION	V1: -0.5%~ 0.5%	I/P: 85VAC~ 305VAC O/P:FULL LOAD Ta:25°C	V1: -0.14 %~ 0.036 %
4	LOAD REGULATION	V1: -0.5%~ 0.5%	I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C	V1: -0.036 %~ 0.07 %
5	OVER/UNDERSHOOT TEST	< ± 5%	I/P: 230VAC O/P:FULL LOAD Ta:25°C	2.4 %
6	RIPPLE & NOISE (Max)	V1: 200mVp-p	I/P: 230VAC O/P:FULL LOAD Ta:25°C	V1: 114 mVp-p / 100% load

high frequency :

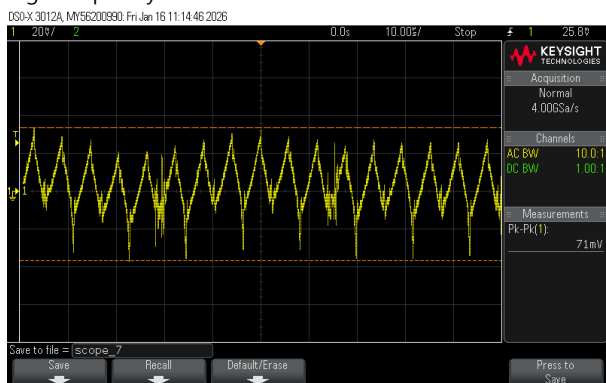


low frequency :

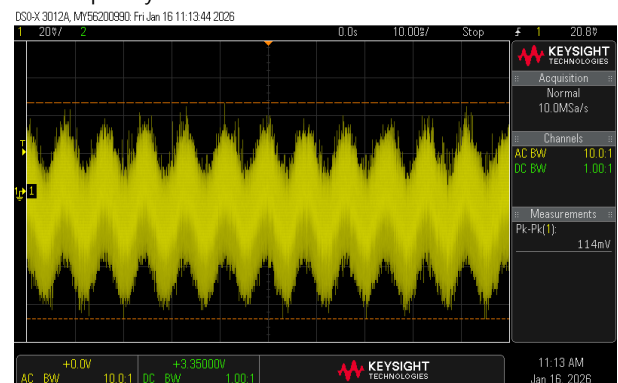


7	SET UP TIME(Max)	277VAC/1500ms 230VAC/1500ms 115VAC/2500ms	I/P : 277VAC I/P : 230VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	277VAC/1100ms 230VAC/1100ms 115VAC/ 1113ms
---	------------------	---	--	--


INPUT=277VAC/60HZ @ FULL LOAD  
CH1 : Output Voltage CH2 : AC Input Voltage

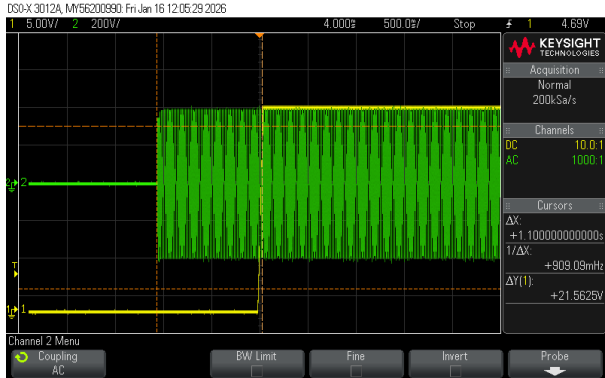

INPUT=230VAC/50HZ @ FULL LOAD  
CH1 : Output Voltage CH2 : AC Input Voltage

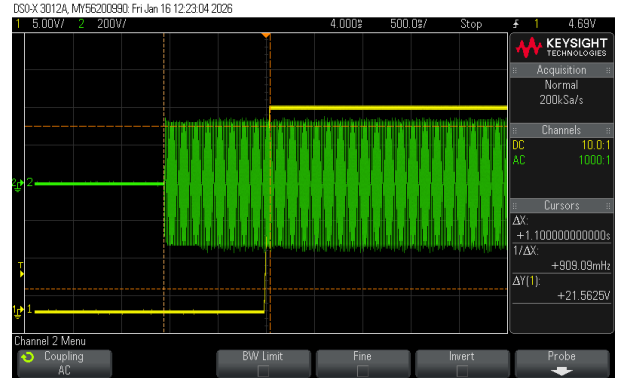

INPUT=115VAC/60HZ @ FULL LOAD  
CH1 : Output Voltage CH2 : AC Input Voltage

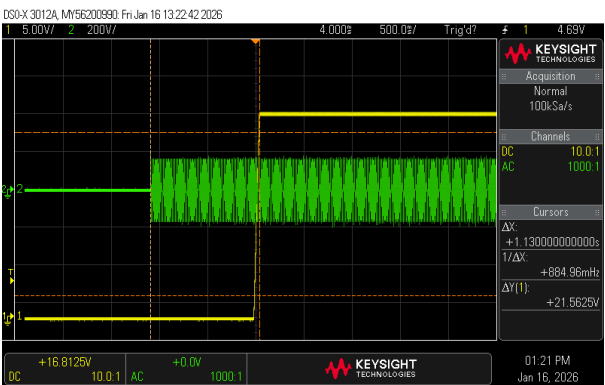


8 RISE TIME (Max)

277VAC/80ms  
230VAC/80ms  
115VAC/80ms


I/P : 277VAC  
I/P : 230VAC  
I/P : 115VAC  
O/P : FULL LOAD  
Ta : 25°C






277VAC/44.6 ms  
230VAC/ 44.6ms  
115VAC/ 44.6ms

INPUT=277VAC/60HZ @ FULL LOAD  
CH1 : Output Voltage

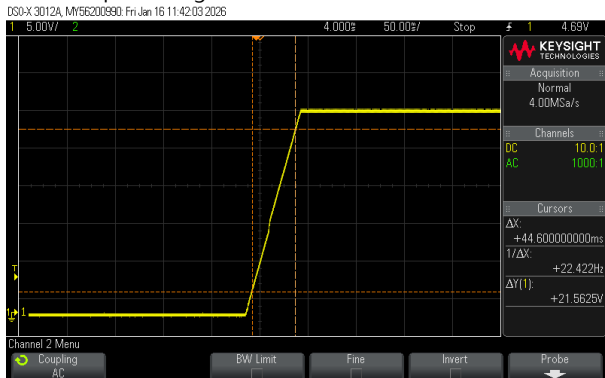

INPUT=230VAC/50HZ @ FULL LOAD  
CH1 : Output Voltage

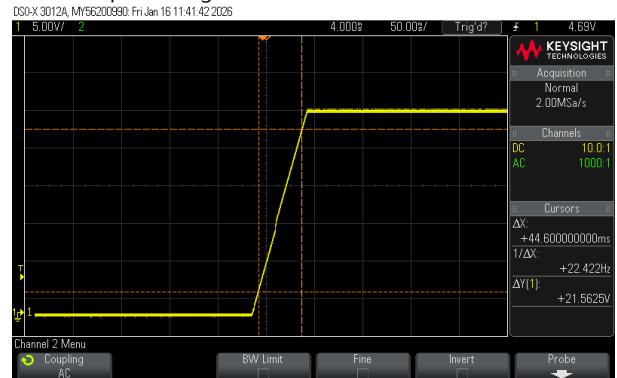

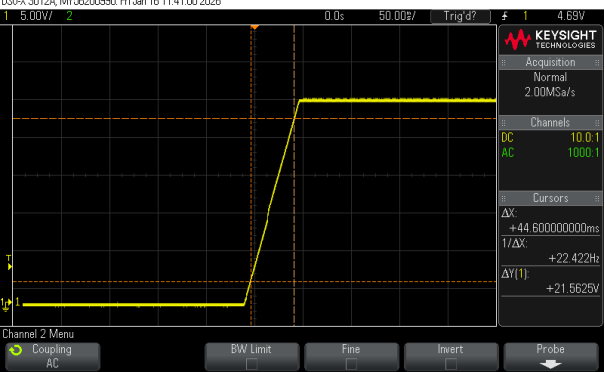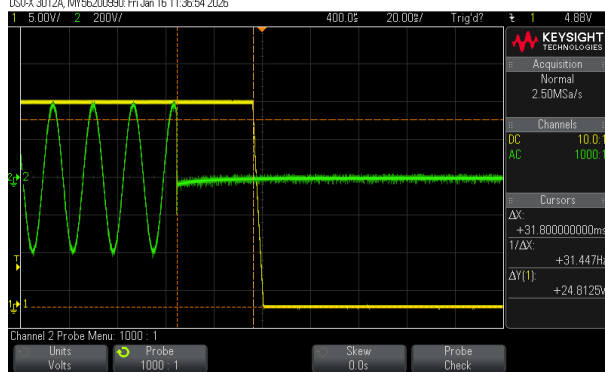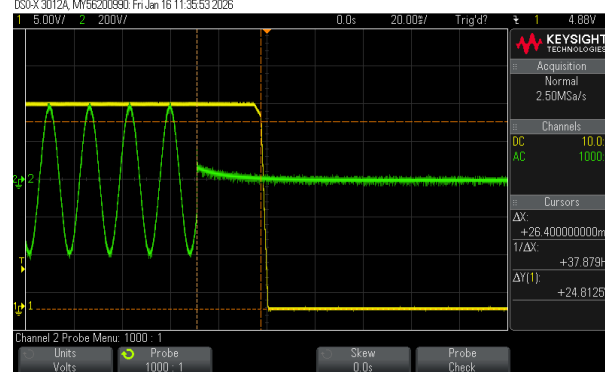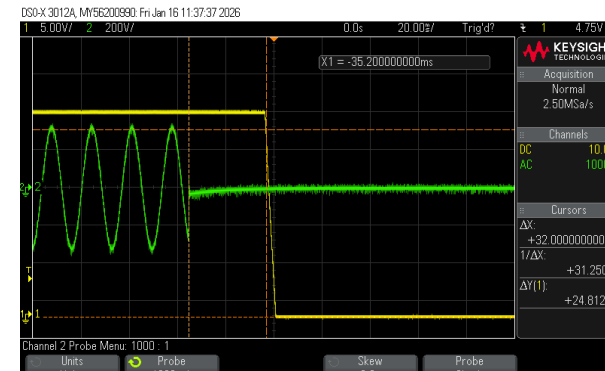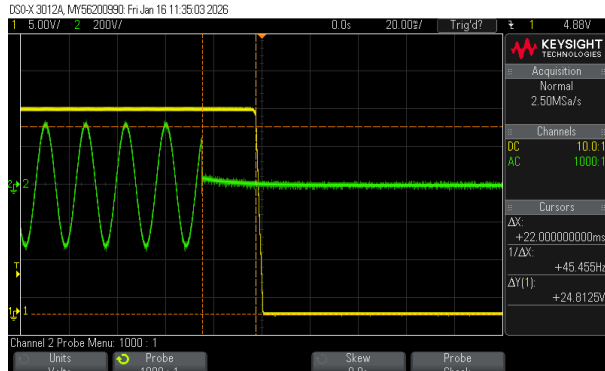
	<p>INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage</p> 		
9	<p>HOLD UP TIME (Typ.) 12ms@70%load 8ms@full load</p>	<p>I/P : 277 VAC I/P : 230VAC I/P : 115 VAC O/P : 70%LOAD/FULL LOAD Ta : 25°C</p>	<p>277VAC: 31.8 ms/ 26.4ms 230VAC: 32ms/ 22ms 115VAC: 33.6ms/ 22.8ms</p>
<p>INPUT=277VAC/60HZ@70% LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> 		<p>INPUT=277VAC/60HZ@FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> 	
<p>INPUT=230VAC/50HZ@70% LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> 		<p>INPUT=230VAC/50HZ@FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p> 	

	<p>INPUT=115VAC/60HZ@70% LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p>		<p>INPUT=115VAC/60HZ@FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage</p>	
10	DYNAMIC LOAD	V1: 5400mVp-p	<p>I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C</p>	<p>2390mVp-p 1000mVp-p</p>
<p>FULL /50% LOAD 50%DUTY / 120HZ</p>		<p>FULL /50% LOAD 50%DUTY / 1KHZ</p>		

### INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	85VAC~305VAC 120VDC~ 431VDC	(1) I/P:TESTING O/P:FULL LOAD (2) I/P:DC TESTING(L:+ N:-) O/P: FULL / 50% LOAD (3) I/P:DC TESTING(L:- N:+) O/P: FULL / 50% LOAD Ta:25°C	(1) 82 V~308V (2) 117Vdc~434Vdc/FULL LOAD 117Vdc~434Vdc/50% LOAD (3) 117Vdc~434Vdc/FULL LOAD 117Vdc~434Vdc/50% LOAD
			I/P: LOW-LINE-3V=82V HIGH-LINE+10V=315 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN ( POWER ON/OFF NO DAMAGE )	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:85VAC ~264 VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT (Typ.)	277V/ 5A 230V/ 6A 115V/ 12A	I/P : 277VAC I/P : 230VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	I =3.97A/ 277VAC I =4.71A/ 230VAC I =9.59A/ 115VAC
4	LEAKAGE CURRENT	Earth leakage current < 350μA(rms)@277VAC	I/P : 277 VAC O/P : Min LOAD Ta : 25°C	L-FG : 224.6 μA N-FG : 226.2 μA
		Touch current <100μA (rms)@277 VAC		L-V+ : 79.4 μA L-V- : 78.1 μA N-V+ : 79.4 μA N-V- : 78.2 μA
5	POWER FACTOR (Typ.)	0.92/277VAC 0.95/ 230VAC 0.98/ 115VAC	I/P : 277VAC I/P : 230VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	PF=0.963/277VAC PF=0.983/230VAC PF=0.996/115VAC

P.F vs LOAD

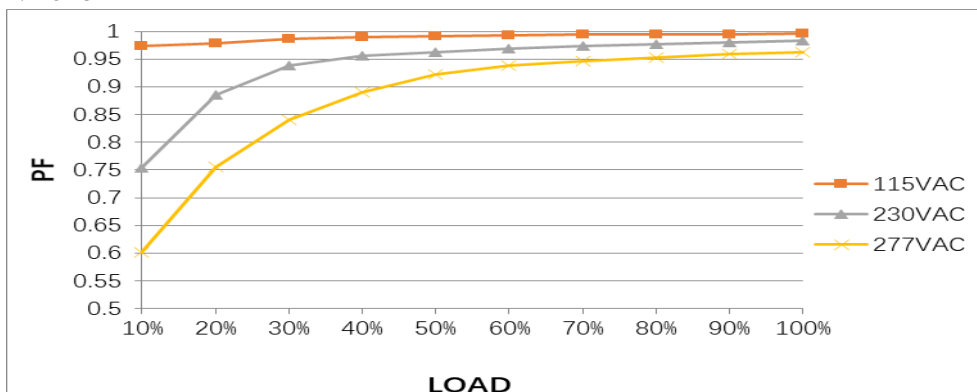





6	EFFICIENCY(Typ.)	93%	I/P:230 VAC O/P:FULL LOAD Ta:25°C	93.48%																																												
<p>EFFICIENCY vs LOAD</p> <table border="1"> <caption>Efficiency vs Load Data</caption> <thead> <tr> <th>LOAD (%)</th> <th>115VAC (%)</th> <th>230VAC (%)</th> <th>277VAC (%)</th> </tr> </thead> <tbody> <tr><td>10%</td><td>80</td><td>81</td><td>81</td></tr> <tr><td>20%</td><td>87</td><td>89</td><td>89</td></tr> <tr><td>30%</td><td>90</td><td>92</td><td>92</td></tr> <tr><td>40%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>50%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>60%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>70%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>80%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>90%</td><td>91</td><td>93</td><td>93</td></tr> <tr><td>100%</td><td>90</td><td>93</td><td>93</td></tr> </tbody> </table>					LOAD (%)	115VAC (%)	230VAC (%)	277VAC (%)	10%	80	81	81	20%	87	89	89	30%	90	92	92	40%	91	93	93	50%	91	93	93	60%	91	93	93	70%	91	93	93	80%	91	93	93	90%	91	93	93	100%	90	93	93
LOAD (%)	115VAC (%)	230VAC (%)	277VAC (%)																																													
10%	80	81	81																																													
20%	87	89	89																																													
30%	90	92	92																																													
40%	91	93	93																																													
50%	91	93	93																																													
60%	91	93	93																																													
70%	91	93	93																																													
80%	91	93	93																																													
90%	91	93	93																																													
100%	90	93	93																																													
7	INRUSH CURRENT(Typ.)	50A/277VAC 40A/230VAC 25A/115VAC COLD START	I/P : 277VAC I/P : 230VAC I/P : 115VAC O/P : FULL LOAD Ta : 25°C	I =34.8A/ 277VAC T50= 3460 us/277V  I =26.8A/230VAC T50= 2160us/230V  I =12.8A/ 115VAC T50= 1680 us/115V																																												
<p>INPUT=277VAC/50HZ @ FULL LOAD CH2 : AC Input Voltage CH1 : Input current</p> <p>INPUT=230VAC/50HZ @ FULL LOAD CH2 : AC Input Voltage CH1 : Input current</p> <p>INPUT=115VAC/50HZ @ FULL LOAD CH2 : AC Input Voltage CH1 : Input current</p>																																																

### PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	105 % ~ 200 %	I/P: 305VAC I/P: 230VAC I/P: 85VAC O/P: TESTING Ta:25°C	112.2%/ 305VAC 112.1%/ 230VAC 112.2%/85VAC Protection type : <b>Peak Load Mode</b> From 105% to 200% of rated output power, unit will shut down after 5 seconds of continuous operation. AC re-power on to recover. At >200% of rated output power, constant current limiting is activated. Unit will shut down after 5 seconds of continuous operation. AC re-power on to recover.  <b>Current Limiting Mode:</b> Constant current limiting, recovers automatically after abnormal condition is removed
2	OVER VOLTAGE PROTECTION	33V~42V	I/P: 305VAC I/P: 230VAC I/P: 85VAC O/P: MIN LOAD Ta:25°C	37V/ 305VAC 37V/ 230VAC 37V/ 85VAC Protection type : Shut down and latch off output voltage, re-power on to recover
3	OVER TEMPERATURE PROTECTION	NO DAMAGE	I/P: 305VAC I/P: 85VAC O/P: FULL LOAD	NO DAMAGE Protection type : Shut down output voltage, recovers automatically after temperature goes down
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 305VAC I/P: 85VAC O/P: FULL LOAD Ta:25°C	NO DAMAGE Protection type : <b>Peak Load Mode:</b> Constant current limiting, unit will shut down after 5 Sec, AC re-power on to recover  <b>Current Limiting Mode:</b> Constant current limiting, recovers automatically after abnormal condition is removed.

### CONTROL FUNCTION TEST

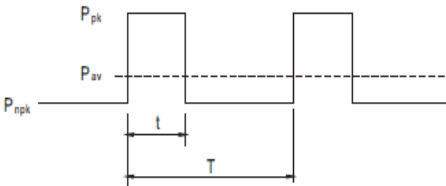
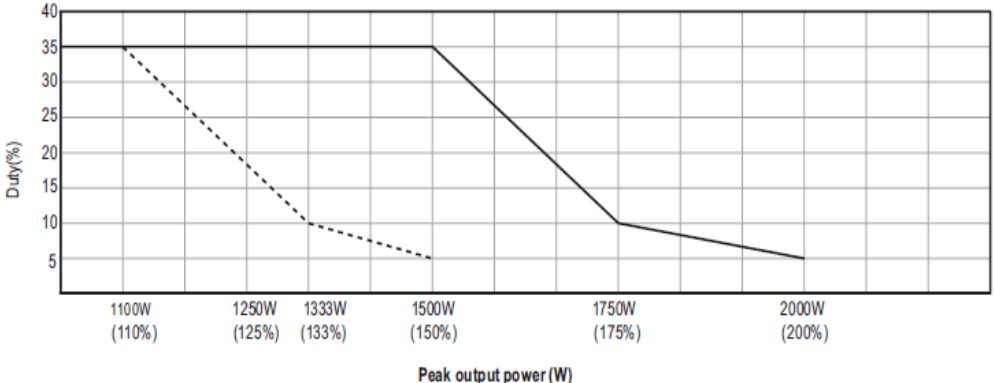
NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PEAK POWER	<p><b>Function Manual</b></p> <p><b>1. Peak Power</b></p> $P_{av} = \frac{P_{pk} \times t + P_{npk} \times (T-t)}{T} \leq P_{rated}$ $Duty = \frac{t}{T} \times 100\% \leq 35\%$ $t \leq 5 \text{ sec}$  <p> <math>P_{av}</math>: Average output power (W)  <math>P_{pk}</math>: Peak output power (W)  <math>P_{npk}</math>: Non-peak output power (W)  <math>P_{rated}</math>: Rated output power (W)  <math>t</math>: Peak power width(sec)  <math>T</math>: Period(sec)         </p>  <p> <b>For example (24V model)</b>  <math>V_{in}=220\text{Vac}</math>, <math>Duty\_max=5\%</math>  <math>P_{av}=P_{rated}=1000\text{W}</math>  <math>P_{pk}=2000\text{W}</math>  <math>t \leq 5\text{sec}</math>  <math>T \geq \frac{5\text{sec}}{5\%} = 100\text{sec}</math>  <math>P_{npk} \leq \frac{TP_{av} - tP_{pk}}{T-t} = 947.4\text{W}</math> </p> <p>Note: When the output voltage is adjusted to the upper limit, the peak power is 150% of rated power</p>		

I/P: 100/200 VAC  
 O/P: PEAK LOAD  
 Ta: 25°C  
 TEST RESULT : PASS

2 OUTPUT VOLTAGE PROGRAMMABLE(PV)

**2.Output Voltage Programming(P.V)**

- (1)Default by potentiometer (SVR)
  - (a)Set DIP switch position-3 to OFF(refer to the illustration on the right).
  - (b)Output voltage can be trimmed by SVR.
- (2)By Output Voltage Programming
  - (a)Set DIP switch position-3 to ON(refer to the illustration on the right).
  - (b)The output voltage can be trimmed to 0~120% by applying EXTERNAL VOLTAGE between PV and GND on CN1.

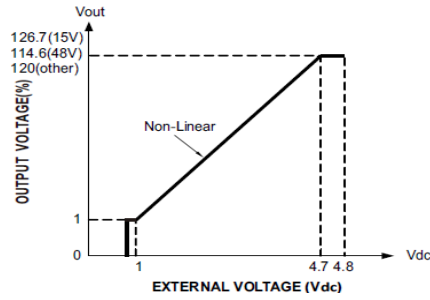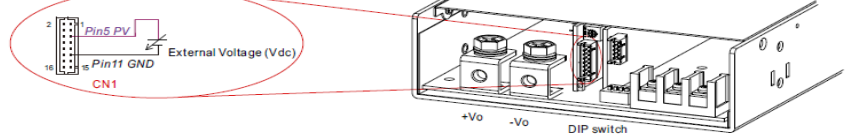



I/P: 230 VAC  
 O/P:FULL LOAD  
 Ta:25°C  
 TEST RESULT :

External voltage(DC)	<0.4V	1V	2.524V	4.7V	4.8V
SPEC(%)	0%	0%~6%	50%±5%	120%±5%	120%±5%
Vout(%)	0%	0.386V(1.43%)	13.82V(51.19%)	31.31V(115.96%)	31.32V(116%)

3 OUTPUT CURRENT PROGRAMMABLE (PC)











**3.Output Current Programming(P.C)**



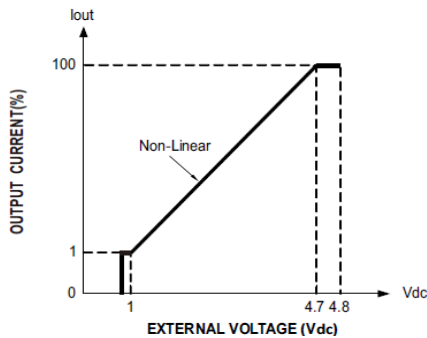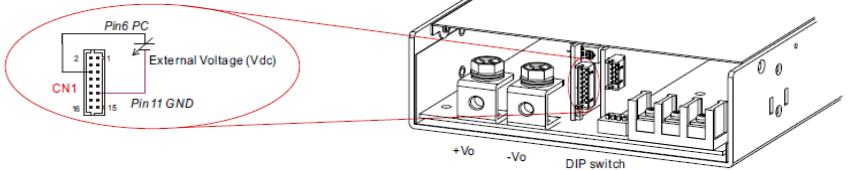





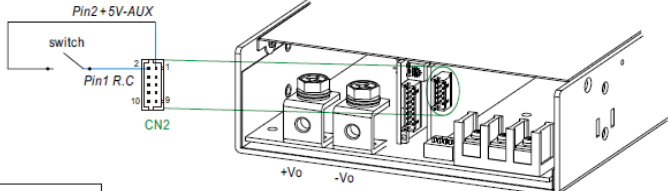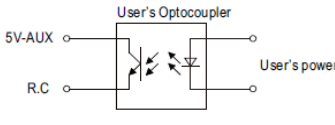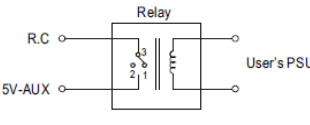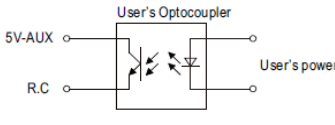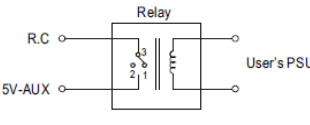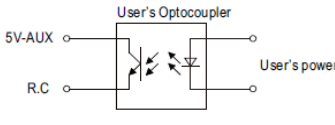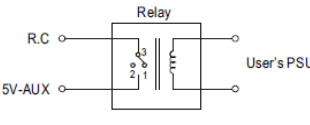







































- (1)Default Overload Protection(OLP) value
  - (a)Set DIP switch position-2 to OFF(refer to the illustration on the right).
  - (b)Output current is set default value.
- (2)By Constant Current Level Programming
  - (a)Set DIP switch position-2 to ON(refer to the illustration on the right).
  - (b)The constant current level can be trimmed to 0~100% of the rated current by applying EXTERNAL VOLTAGE between PC and GND on CN1.



I/P: 230 VAC  
 O/P:TESTING  
 Ta:25°C

External voltage(DC)	<0.4V	1V	2.831V	4.7V	4.8V
SPEC(%)	0%	0%±6%	50%±5%	100%±5%	100%±5%
Iout(%)	0%	2.34%	48.59%	97.38%	99.30%

<p>4</p>	<p>REMOTE CONTROL</p>	<p><b>4.Remote Control</b></p> <p>※ The power supply can be turned ON/OFF individually or along with other units by using the "Remote Control" function with external switch, potocoupler or relay.</p>  <table border="1" data-bbox="491 542 930 631"> <tr> <td>PSU Vo Status</td> <td>Between +5V-AUX(Pin 2) and R.C(Pin 1)</td> </tr> <tr> <td>Power ON</td> <td>Switch Short</td> </tr> <tr> <td>Power OFF</td> <td>Switch Open</td> </tr> </table> <table border="1" data-bbox="491 656 1353 880"> <tr> <td data-bbox="491 656 657 824">  </td> <td data-bbox="657 656 1018 824">  </td> <td data-bbox="1018 656 1353 824">  </td> </tr> <tr> <td>R.C. by external switch.</td> <td>R.C. by user's optocoupler control module.</td> <td>R.C. by user's Relay control module.</td> </tr> </table> <p>I/P: 230 VAC  O/P:FULL LOAD  Ta:25°C  Test Result :</p> <table border="1" data-bbox="466 1025 1189 1142"> <tr> <td>Between +5V-AUX(Pin2) and R.C(Pin1)</td> <td>Power Supply Status</td> </tr> <tr> <td>SW SHORT</td> <td>ON</td> </tr> <tr> <td>SW OPEN</td> <td>OFF</td> </tr> </table>	PSU Vo Status	Between +5V-AUX(Pin 2) and R.C(Pin 1)	Power ON	Switch Short	Power OFF	Switch Open				R.C. by external switch.	R.C. by user's optocoupler control module.	R.C. by user's Relay control module.	Between +5V-AUX(Pin2) and R.C(Pin1)	Power Supply Status	SW SHORT	ON	SW OPEN	OFF
PSU Vo Status	Between +5V-AUX(Pin 2) and R.C(Pin 1)																			
Power ON	Switch Short																			
Power OFF	Switch Open																			
																				
R.C. by external switch.	R.C. by user's optocoupler control module.	R.C. by user's Relay control module.																		
Between +5V-AUX(Pin2) and R.C(Pin1)	Power Supply Status																			
SW SHORT	ON																			
SW OPEN	OFF																			
<p>5</p>	<p>REMOTE SENSE</p>	<p>S+ / S-&gt;0.5V  Compensate voltage drop on the load wiring up to 0.5V.</p> <p>I/P: 230 VAC  O/P:FULL LOAD  Ta:25°C</p> <p>&gt; 0.5V</p>																		
<p>6</p>	<p>AUXILIARY POWER</p>	<p>1.Auxiliary voltage output, 10.2~13.8V, referenced to GND-AUX (pin2).  The maximum load current is 0.8A. This output has the built-in "Oring diodes" and is not controlled by "Remote ON-OFF".</p> <p>2.Auxiliary voltage output, 4.25~5.75v, referenced to GND-AUX (pin2).  The maximum load current is 0.3A. This output has the built-in "Oring diodes" and is not controlled by "Remote ON-OFF"</p> <p>I/P: 230 VAC  O/P:FULL LOAD  Ta:25°C  Test Result :</p> <table border="1" data-bbox="547 1630 1385 1774"> <tr> <th>AUX</th> <th>TOLERANCE</th> <th>RIPPLE</th> <th>TEST RESULT</th> </tr> <tr> <td>12V / 0.8A</td> <td>10.2~13.8 V</td> <td>450mVp-p</td> <td>11.97V/ 31mV</td> </tr> <tr> <td>5V / 0.2A</td> <td>4.25~5.75 V</td> <td>150mVp-p</td> <td>4.98V/ 34mV</td> </tr> </table>	AUX	TOLERANCE	RIPPLE	TEST RESULT	12V / 0.8A	10.2~13.8 V	450mVp-p	11.97V/ 31mV	5V / 0.2A	4.25~5.75 V	150mVp-p	4.98V/ 34mV						
AUX	TOLERANCE	RIPPLE	TEST RESULT																	
12V / 0.8A	10.2~13.8 V	450mVp-p	11.97V/ 31mV																	
5V / 0.2A	4.25~5.75 V	150mVp-p	4.98V/ 34mV																	
<p>7</p>	<p>DC OK SIGNAL</p>	<p>I/P:230VAC  O/P: FULL LOAD  Ta:25°C  TEST : OK</p>																		

8	LED Status indicators	<p>※ LED Status Indicators</p> <table border="1" data-bbox="470 300 1500 1077"> <thead> <tr> <th data-bbox="470 300 938 342">Description</th> <th colspan="3" data-bbox="938 300 1500 342">Output of alarm</th> </tr> </thead> <tbody> <tr> <td data-bbox="470 342 938 423">Normal operation</td> <td data-bbox="938 342 1193 423">Green : Steadily lit</td> <td data-bbox="1193 342 1268 423"></td> <td data-bbox="1268 342 1500 423"></td> </tr> <tr> <td data-bbox="470 423 938 504">Remote off</td> <td data-bbox="938 423 1193 504">Red : Steadily lit</td> <td data-bbox="1193 423 1268 504"></td> <td data-bbox="1268 423 1500 504"></td> </tr> <tr> <td data-bbox="470 504 938 584">Internal over-temperature</td> <td data-bbox="938 504 1193 584">Orange : 1 Blink/Pause</td> <td data-bbox="1193 504 1268 584"></td> <td data-bbox="1268 504 1500 584"></td> </tr> <tr> <td data-bbox="470 584 938 665">Overload/Short</td> <td data-bbox="938 584 1193 665">Red : 1 Blink/Pause</td> <td data-bbox="1193 584 1268 665"></td> <td data-bbox="1268 584 1500 665"></td> </tr> <tr> <td data-bbox="470 665 938 745">Over voltage</td> <td data-bbox="938 665 1193 745">Red : 2 Blink/Pause</td> <td data-bbox="1193 665 1268 745"></td> <td data-bbox="1268 665 1500 745"></td> </tr> <tr> <td data-bbox="470 745 938 826">Over temperature</td> <td data-bbox="938 745 1193 826">Red : 3 Blink/Pause</td> <td data-bbox="1193 745 1268 826"></td> <td data-bbox="1268 745 1500 826"></td> </tr> <tr> <td data-bbox="470 826 938 907">Fan fail</td> <td data-bbox="938 826 1193 907">Red : 4 Blink/Pause</td> <td data-bbox="1193 826 1268 907"></td> <td data-bbox="1268 826 1500 907"></td> </tr> <tr> <td data-bbox="470 907 938 987">AC under voltage</td> <td data-bbox="938 907 1193 987">Red : 5 Blink/Pause</td> <td data-bbox="1193 907 1268 987"></td> <td data-bbox="1268 907 1500 987"></td> </tr> <tr> <td data-bbox="470 987 938 1077">Others (Note)</td> <td data-bbox="938 987 1193 1077">Red : 6 Blink/Pause</td> <td data-bbox="1193 987 1268 1077"></td> <td data-bbox="1268 987 1500 1077"></td> </tr> </tbody> </table> <p data-bbox="470 1093 1412 1144">           Note: 1. Others include hardware fault etc.            2. In PC mode, both OLP and SCP operate in constant current limiting, with the indicator steadily lit green.         </p> <p data-bbox="470 1189 630 1323">           I/P:230VAC            O/P:FULL LOAD            Ta:25°C            TEST :PASS         </p>			Description	Output of alarm			Normal operation	Green : Steadily lit			Remote off	Red : Steadily lit			Internal over-temperature	Orange : 1 Blink/Pause			Overload/Short	Red : 1 Blink/Pause			Over voltage	Red : 2 Blink/Pause			Over temperature	Red : 3 Blink/Pause			Fan fail	Red : 4 Blink/Pause			AC under voltage	Red : 5 Blink/Pause			Others (Note)	Red : 6 Blink/Pause		
Description	Output of alarm																																											
Normal operation	Green : Steadily lit																																											
Remote off	Red : Steadily lit																																											
Internal over-temperature	Orange : 1 Blink/Pause																																											
Overload/Short	Red : 1 Blink/Pause																																											
Over voltage	Red : 2 Blink/Pause																																											
Over temperature	Red : 3 Blink/Pause																																											
Fan fail	Red : 4 Blink/Pause																																											
AC under voltage	Red : 5 Blink/Pause																																											
Others (Note)	Red : 6 Blink/Pause																																											
9	FAN NOISE (Typ.)	10% load @18 dB 70% load @24 dB  Built-in intelligent fan speed control detect by PSU' S internal temperature	I/P : 230 VAC O/P : TESTING Ta : 25°C	10% load: 16.27dB 70% load: 22.71dB																																								

## COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor ( D to S) or (C to E) Peak Voltage	Q53 Rated:650V/33.7A	AC ON/OFF I/P:High-Line +3V =308V VDS: O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. (8)0%~150%LOAD (9)0%LOAD~SHORT  I/P:Low-Line -3V = 82V O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. Ta:25°C	VDS: (1) 426V (2) 422V (3) 426V  (4) 426V (5) 426V (6) 426V (7) 426V (8) 36.2V (9) 38.2V  VDS: (1) 450V (2) 434V (3) 446V (4) 438V (5) 430V (6) 438V (7) 434V
2	Diode Peak Voltage	Q100 Rated 185A/150V  Q103 Rated 185A/150V	AC ON/OFF I/P:High-Line +3V =308 V O/P: (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→400% Load. (8).NO LOAD Ta:25°C	Q101: VDS: (1) 105.8V (2) 105.8V (3) 109.1V (4) 109.1V (5) 109.1V (6) 109.1V (7) 109.1V (8) 109.1V

				Q104: VDS: (1) 108.3V (2) 106.6V (3) 109.1V (4) 110.7V (5) 111.5V (6) 110.7V (7) 107.4V (8) 109.1V
3	Input Capacitor Voltage	C5 Rated: 470μ/450V Surge voltage: 495V	I/P:High-Line +3V =308V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change (4)Full load continue Ta:25°C	(1)447V (2)430V (3)451V (4)443V
4	Control IC Voltage Test	PWM IC U500 Rated 8V~30V  PFC IC U1 Rated 11.9V~25V  O/P IC U100 Rated 4.2V~30V	AC ON/OFF I/P:High-Line +3V =308 V O/P(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. (5)NO LOAD VRmin(Low LINE) Ta:25°C	U500 (1) 17.1V (2) 17.1V (3) 14.7V (4) 17.1V (5) 17.1V  U1 (1) 17.02V (2) 17.12V (3) 17.02V (4) 17.02V (5) 17.12V  U100 (1) 12.1V (2) 12.1V (3) 12.3V (4) 12.3V (5) 12.1V

## ■ SAFETY & E.M.C. TEST

### SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 4 K VAC/min I/P-FG : 2 K VAC/min O/P-FG: 1.5 KVAC/min	I/P-O/P: 4.4 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG: 1.8 KVAC/min Ta:25°C	I/P-O/P: 3.251 mA I/P-FG: 2.828 mA O/P-FG: 1.863 mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P: 500 VDC>100MΩ I/P-FG: 500 VDC>100MΩ O/P-FG: 500 VDC >100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P: 9999 MΩ I/P-FG: 9999 MΩ O/P-FG: 9999 MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	13mΩ

### E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:230VAC/50HZ O/P:FULL LOAD Ta:25°C	PASS
2	CONDUCTION	EN55032 EN55014-1 EN55011	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
3	RADIATION	EN55032 EN55014-1 EN55011	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 AIR : 15KV / Contact : 8KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
5	E.F.T	EN61000-4-4 INPUT : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
6	SURGE	IEC61000-4-5 L-N : 2KV L,N-PE : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			

## ■ RELIABILITY TEST

### ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																								
1	TEMPERATURE RISE TEST	MODEL : NSP-1000-24 1. ROOM AMBIENT BURN-IN : 2HRS I/P : 230VAC O/P : FULL LOAD Ta=27.5 °C 2. HIGH AMBIENT BURN-IN : 2HRS I/P : 230VAC O/P : FULL LOAD Ta=60.9 °C																																																																																																										
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=27.5 °C</th> <th>HIGH AMBIENT Ta=60.9 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF2</td><td>34.2°C</td><td>67.6°C</td></tr> <tr><td>2</td><td>BD1</td><td>52.7°C</td><td>86.1°C</td></tr> <tr><td>3</td><td>Q1</td><td>53.3°C</td><td>86.7°C</td></tr> <tr><td>4</td><td>D4</td><td>50.7°C</td><td>84.1°C</td></tr> <tr><td>5</td><td>L1</td><td>41.2°C</td><td>74.6°C</td></tr> <tr><td>6</td><td>C5</td><td>36.4°C</td><td>69.8°C</td></tr> <tr><td>7</td><td>U1</td><td>40.6°C</td><td>74.0°C</td></tr> <tr><td>8</td><td>U2</td><td>45.4°C</td><td>78.8°C</td></tr> <tr><td>9</td><td>Q50</td><td>55.5°C</td><td>88.9°C</td></tr> <tr><td>10</td><td>Q51</td><td>59.4°C</td><td>92.8°C</td></tr> <tr><td>11</td><td>Q52</td><td>50.3°C</td><td>83.7°C</td></tr> <tr><td>12</td><td>Q53</td><td>52.8°C</td><td>86.2°C</td></tr> <tr><td>13</td><td>L3</td><td>74.2°C</td><td>107.6°C</td></tr> <tr><td>14</td><td>T1</td><td>63.7°C</td><td>97.1°C</td></tr> <tr><td>15</td><td>D100</td><td>59.5°C</td><td>92.9°C</td></tr> <tr><td>16</td><td>L100</td><td>49.8°C</td><td>83.2°C</td></tr> <tr><td>17</td><td>C110</td><td>39.4°C</td><td>72.8°C</td></tr> <tr><td>18</td><td>U100</td><td>64.1°C</td><td>97.5°C</td></tr> <tr><td>19</td><td>Q102</td><td>56.9°C</td><td>90.3°C</td></tr> <tr><td>20</td><td>R118</td><td>66.4°C</td><td>99.8°C</td></tr> <tr><td>21</td><td>RTH5</td><td>36.6°C</td><td>70.0°C</td></tr> <tr><td>22</td><td>RTH6</td><td>41.6°C</td><td>75.0°C</td></tr> <tr><td>23</td><td>RT31</td><td>41.6°C</td><td>75.0°C</td></tr> <tr><td>24</td><td>RT32</td><td>40.1°C</td><td>73.5°C</td></tr> <tr><td>25</td><td>C14</td><td>35.3°C</td><td>68.7°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta=27.5 °C	HIGH AMBIENT Ta=60.9 °C	1	LF2	34.2°C	67.6°C	2	BD1	52.7°C	86.1°C	3	Q1	53.3°C	86.7°C	4	D4	50.7°C	84.1°C	5	L1	41.2°C	74.6°C	6	C5	36.4°C	69.8°C	7	U1	40.6°C	74.0°C	8	U2	45.4°C	78.8°C	9	Q50	55.5°C	88.9°C	10	Q51	59.4°C	92.8°C	11	Q52	50.3°C	83.7°C	12	Q53	52.8°C	86.2°C	13	L3	74.2°C	107.6°C	14	T1	63.7°C	97.1°C	15	D100	59.5°C	92.9°C	16	L100	49.8°C	83.2°C	17	C110	39.4°C	72.8°C	18	U100	64.1°C	97.5°C	19	Q102	56.9°C	90.3°C	20	R118	66.4°C	99.8°C	21	RTH5	36.6°C	70.0°C	22	RTH6	41.6°C	75.0°C	23	RT31	41.6°C	75.0°C	24	RT32	40.1°C	73.5°C	25	C14	35.3°C	68.7°C
NO	Position	ROOM AMBIENT Ta=27.5 °C	HIGH AMBIENT Ta=60.9 °C																																																																																																									
1	LF2	34.2°C	67.6°C																																																																																																									
2	BD1	52.7°C	86.1°C																																																																																																									
3	Q1	53.3°C	86.7°C																																																																																																									
4	D4	50.7°C	84.1°C																																																																																																									
5	L1	41.2°C	74.6°C																																																																																																									
6	C5	36.4°C	69.8°C																																																																																																									
7	U1	40.6°C	74.0°C																																																																																																									
8	U2	45.4°C	78.8°C																																																																																																									
9	Q50	55.5°C	88.9°C																																																																																																									
10	Q51	59.4°C	92.8°C																																																																																																									
11	Q52	50.3°C	83.7°C																																																																																																									
12	Q53	52.8°C	86.2°C																																																																																																									
13	L3	74.2°C	107.6°C																																																																																																									
14	T1	63.7°C	97.1°C																																																																																																									
15	D100	59.5°C	92.9°C																																																																																																									
16	L100	49.8°C	83.2°C																																																																																																									
17	C110	39.4°C	72.8°C																																																																																																									
18	U100	64.1°C	97.5°C																																																																																																									
19	Q102	56.9°C	90.3°C																																																																																																									
20	R118	66.4°C	99.8°C																																																																																																									
21	RTH5	36.6°C	70.0°C																																																																																																									
22	RTH6	41.6°C	75.0°C																																																																																																									
23	RT31	41.6°C	75.0°C																																																																																																									
24	RT32	40.1°C	73.5°C																																																																																																									
25	C14	35.3°C	68.7°C																																																																																																									
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR ( MIN )	I/P : 230 VAC O/P : 112 % LOAD Ta : 25°C	TEST : OK																																																																																																								
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 305VAC/100VAC O/P : 60%/ 100 % LOAD Ta= -45/-35 °C	TEST : OK																																																																																																								



4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 60 °C/95 %R.H NO DAMAGE	I/P : 315 VAC O/P : FULL LOAD Ta= 65 °C HUMIDITY= 95 %R.H	TEST : OK
5	TEMPERATURE COEFFICIENT	±0.03 %/°C(0~60°C)	I/P : 230 VAC O/P : FULL LOAD	± 0.0023 %/°C(0~60°C)
6	STORAGE TEMPERATURE TEST	-40~85°C	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/output condition : STATIC	
7	THERMAL SHOCK TEST	-30~60°C	1. Thermal shock Temperature : -35°C~ +65°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/output condition : 15cycle:230V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:230V/ FULL LOAD Burn In Test	
8	VIBRATION TEST	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes	(1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 3G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C	
9	CAPACITOR LIFE CYCLE	SUPPOSE C110 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta=25 °C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta=60 °C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta=60 °C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta=60 °C LIFE TIME	(1) 796346HRS (2) 140775HRS (3) 198948HRS (4) 236666HRS	
10	MTBF	Conducted by Parts Stress Analysis Prediction 910.8K hrs min. Telcordia SR-332 (Bellcore) ; 87.5K hrs min. MIL-HDBK-217F (25°C)		
11	Ongoing Reliability Test	I/P : 230VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 50,000 hours		

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	WUWQIN/ZHOUBIAO	WENF	WUWQ

2020.10.1 TAG-QA-009