



Test Report: RHB-8K1U-24

1600~8000W 1U Distributed Power/Charger System

■ DESIGN VERIFY TEST

Output Function Test
Input Function Test
Control Function Test

■ SAFETY & E.M.C. TEST

Safety Test
E.M.C. Test

■ RELIABILITY TEST

ENVIRONMENT TEST

■ DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	BOOST CHARGE VOLTAGE(Vboost)(default)	Default, programmable 28.8V±0.24V	I/P: 230 VAC O/P: CV MODE Ta:25°C	28.859V
2	FLOAT CHARGE VOLTAGE	Default, programmable 27.6V±0.24V	I/P: 230 VAC O/P: CV MODE Ta:25°C	27.646V
3	OUTPUT CURRENT	275A±5.5A	I/P: 230 VAC O/P:CV MODE-2V Ta:25°C	275A
4	VOLTAGE ADJ. RANGE	23.5V~30V DIP switch position 4 : OFF	I/P: 230 VAC O/P:NO LOAD Ta:25°C	22.6V~30.72V/230VAC 22.6V~30.72V/115VAC
5	LEAKAGE CURRENT FROM BATTERY (Typ.)	<1mA	I/P: AC OFF O/P:BATTERY Ta:25°C	3uA


INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	90VAC~264VAC	I/P:TESTING O/P:FULL LOAD Ta:25°C	149V~264V
			I/P: (1)LOW-LINE-3V=87 V HIGH-LINE+15%=300 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (2)230Vac ON: 0.5 Sec OFF: 0.5 Sec 20MIN (3)230Vac ON:3Sec OFF:3Sec 12HOURS (POWER ON/OFF NO DAMAGE)	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:100 VAC ~264 VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	AC CURRENT (Typ.) per RECTIFIER	230V/ 8.5 A 115V/ 15 A	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I =7.83A/ 230VAC I =12.77A/ 115VAC
4	LEAKAGE CURRENT per RECTIFIER	<1.5 mA / 230 VAC	I/P : 230 VAC O/P : Min LOAD Ta : 25°C	L-FG : 0.8 mA N-FG : 0.8 mA




CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																		
1	AUXILIARY POWER (AUX)	1. $5V \pm 10\% @ 0.3A$ ripple:150mVp-p 2. $12V \pm 10\% @ 0.8A$ ripple:250mVp-p	I/P: 230 VAC O/P:FULL LOAD Ta:25°C	$4.741V/0.3A$: ripple:14mVp-p $11.36V/0.8A$: ripple: 156 mVp-p																		
2	REMOTE ON/OFF CONTROL	The PSU can be turned ON/OFF together or separately by using the "Remote ON/OFF" function.  <p style="text-align: center;">I/P: 230 VAC O/P:FULL LOAD Ta:25°C</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Between ON/OFF and +5V-AUX</th> <th>OUTPUT</th> </tr> </thead> <tbody> <tr> <td>SW SHORT</td> <td>ON</td> </tr> <tr> <td>SW OPEN</td> <td>OFF</td> </tr> </tbody> </table>	Between ON/OFF and +5V-AUX	OUTPUT	SW SHORT	ON	SW OPEN	OFF														
Between ON/OFF and +5V-AUX	OUTPUT																					
SW SHORT	ON																					
SW OPEN	OFF																					
3	ALARM SIGNAL	1. DC OK SIGNAL High (4.5 ~ 5.5V) : When the $V_{out} \leq 8V/16V/32V \pm 1V$. Low (0 ~ 0.5V) : When $V_{out} \geq 8V/16V/32V \pm 1V$. The maximum sourcing current is 10mA and only for output. DC OK is associated with battery low protection. I/P: 230 VAC O/P:FULL LOAD Ta:25°C Test Result : <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Vout</th> <th>DC OK SIGNAL</th> </tr> </thead> <tbody> <tr> <td>$V_{out} \leq 75\%$</td> <td>4.985V</td> </tr> <tr> <td>$V_{out} \geq 85\%$</td> <td>-0.09V</td> </tr> </tbody> </table>	Vout	DC OK SIGNAL	$V_{out} \leq 75\%$	4.985V	$V_{out} \geq 85\%$	-0.09V														
Vout	DC OK SIGNAL																					
$V_{out} \leq 75\%$	4.985V																					
$V_{out} \geq 85\%$	-0.09V																					
		2. T-ALARM <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>P.S.U STATUS</th> <th>Vo</th> <th>T-ALARM</th> </tr> </thead> <tbody> <tr> <td>NORMAL</td> <td>$100\% \pm 2\%$</td> <td>-0.1 ~0.5V</td> </tr> <tr> <td>OTP OR FAN LOCK</td> <td>0V</td> <td>4.5~5.5V</td> </tr> </tbody> </table> <p style="text-align: center;">I/P: 230 VAC O/P:FULL LOAD Ta:25°C Test Result :</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>P.S.U STATUS</th> <th>T-ALARM</th> </tr> </thead> <tbody> <tr> <td>NORMAL</td> <td>-0.09 V</td> </tr> <tr> <td>OTP OR FAN LOCK</td> <td>4.936V</td> </tr> </tbody> </table>	P.S.U STATUS	Vo	T-ALARM	NORMAL	$100\% \pm 2\%$	-0.1 ~0.5V	OTP OR FAN LOCK	0V	4.5~5.5V	P.S.U STATUS	T-ALARM	NORMAL	-0.09 V	OTP OR FAN LOCK	4.936V					
P.S.U STATUS	Vo	T-ALARM																				
NORMAL	$100\% \pm 2\%$	-0.1 ~0.5V																				
OTP OR FAN LOCK	0V	4.5~5.5V																				
P.S.U STATUS	T-ALARM																					
NORMAL	-0.09 V																					
OTP OR FAN LOCK	4.936V																					
		3. AC-OK <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>AC IN</th> <th>Vo</th> <th>AC OK</th> </tr> </thead> <tbody> <tr> <td>$AC I/P \geq 87V_{rms}$</td> <td>$100\% \pm 2\%$</td> <td>4.5~5.5V</td> </tr> <tr> <td>$AC I/P \leq 75V_{rms}$</td> <td>0V</td> <td>0~0.5V</td> </tr> </tbody> </table> <p style="text-align: center;">I/P: TEST O/P:60%LOAD Test Result :</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>AC IN</th> <th>Vo</th> <th>AC OK</th> </tr> </thead> <tbody> <tr> <td>$AC I/P \geq 87V$</td> <td>100.4%</td> <td>5.0489V</td> </tr> <tr> <td>$AC I/P \leq 75V$</td> <td>0.002V</td> <td>0.00V</td> </tr> </tbody> </table>	AC IN	Vo	AC OK	$AC I/P \geq 87V_{rms}$	$100\% \pm 2\%$	4.5~5.5V	$AC I/P \leq 75V_{rms}$	0V	0~0.5V	AC IN	Vo	AC OK	$AC I/P \geq 87V$	100.4%	5.0489V	$AC I/P \leq 75V$	0.002V	0.00V		
AC IN	Vo	AC OK																				
$AC I/P \geq 87V_{rms}$	$100\% \pm 2\%$	4.5~5.5V																				
$AC I/P \leq 75V_{rms}$	0V	0~0.5V																				
AC IN	Vo	AC OK																				
$AC I/P \geq 87V$	100.4%	5.0489V																				
$AC I/P \leq 75V$	0.002V	0.00V																				
4	OUTPUT VOLTAGE PROGRAMMABLE(PV)	DIP switch position 4 : OFF																				

※ In addition to the adjustment via the built-in potentiometer, the output voltage can be trimmed by applying EXTERNAL VOLTAGE.

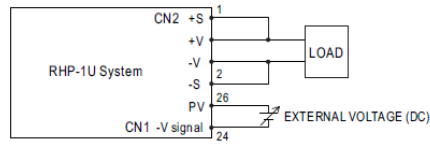

+S & +V, -S & -V also need to be connected on CN1. (Only for power supply system)

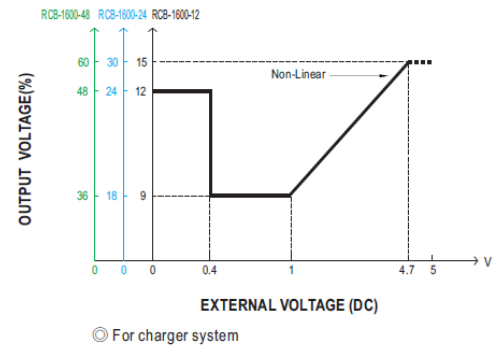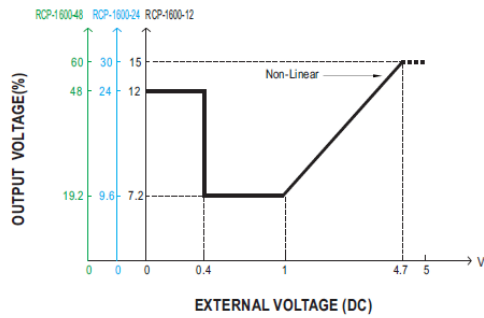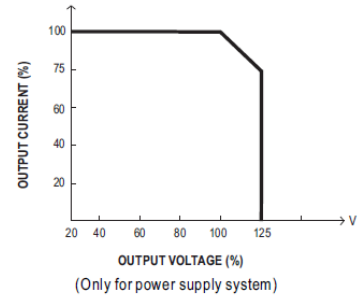

I/P: 230 VAC

O/P: FULL LOAD

Ta: 25°C


Test Result :

MODEL \ PV	<0.4V	1V	4.7V	5V
SPEC	24V±5%	18V±5%	30V±5%	30V±5%
Vout	24.11V	18.03V	30.2V	30.3V


5 OUTPUT CURRENT PROGRAMMABLE (PC)

DIP switch position 4 : OFF


※ The output current can be trimmed to 20~100% of the rated current by applying EXTERNAL VOLTAGE.

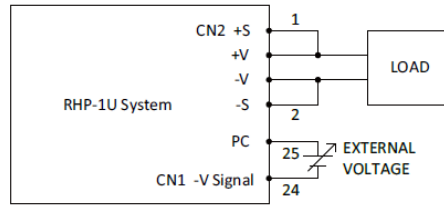

+S & +V, -S & -V also need to be connected on CN1. (Only for power supply system)

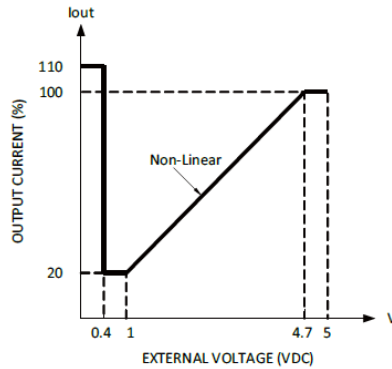

⊙ For power supply system

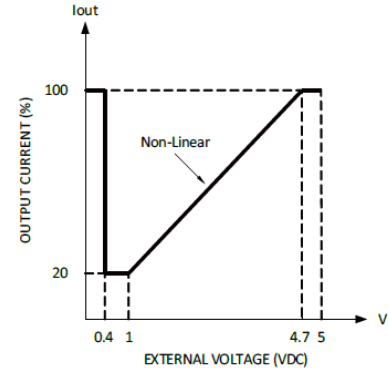

⊙ For charger system

I/P: 230 VAC

O/P: TESTING

Ta: 25°C

Test Result :


ADJ V	<0.4V	1V	4.7V	5V
SPEC	100%±10%	20%±10%	100%±10%	100%±10%
Iout	101%	22.25%	100.7%	101.6%

6 Charging Curve

※ By factory default, this charger performs the default curve which can be programmed via PMBus.

※ To disable / enable the charging curve, change to a 2 stage curve, a different curve frequently used for certain types of batteries in the industry, and so on, please refer to the Installation Manual.

⊙ Default 3 stage charging curve

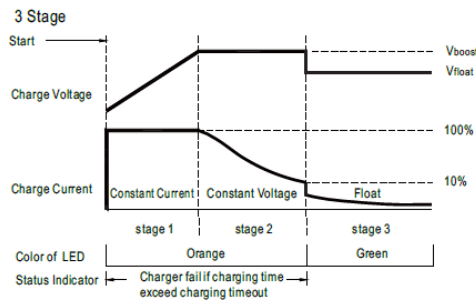

⊙ Suitable for lead-acid batteries (flooded, Gel and AGM) and Li-ion batteries (lithium iron and lithium manganese).

I/P: 230 VAC

O/P: FULL LOAD

Test Result :

⊙ Embedded 3 stage charging curve

MODEL	Description	V _{boost}	V _{float}
12V	Default, programmable	14.4	13.8
	Pre-defined, gel batter	14	13.6
	Pre-defined, flooded battery	14.2	13.4
24V	Pre-defined, AGM battery	14.5	13.5
	Default, programmable	28.8	27.6
	Pre-defined, gel batter	28	27.2
48V	Pre-defined, flooded battery	28.4	26.8
	Pre-defined, AGM battery	29	27
	Default, programmable	57.6	55.2
48V	Pre-defined, gel batter	56	54.4
	Pre-defined, flooded battery	56.8	53.6
	Pre-defined, AGM battery	58	54

MODEL	Constant voltage(V _{boost})	Float (V _{float})	Turn state current
24V	28.8V± 0.24V	27.6V± 0.24V	27.5A± 8.25A
	28.859V	27.646V	28A

7	LED Status Indicators	※ LED Status Indicators									
		<table border="1"> <thead> <tr> <th>LED</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>● Green</td> <td>Float (stage 3)</td> </tr> <tr> <td>● Orange</td> <td>Charging (stage 1 or stage 2)</td> </tr> <tr> <td>● Red</td> <td>The LED will present a constant red light when the abnormal status (OTP, OLP, fan fail and charging timeout) arises.</td> </tr> <tr> <td>● Red (Flashing)</td> <td>The LED will flash with the red light when the internal temperature reaches 60°C; under this condition, the unit still operates normally without entering OTP. (In the meantime, an alarm signal will be sent out through the PMBus interface.)</td> </tr> </tbody> </table>	LED	Description	● Green	Float (stage 3)	● Orange	Charging (stage 1 or stage 2)	● Red	The LED will present a constant red light when the abnormal status (OTP, OLP, fan fail and charging timeout) arises.	● Red (Flashing)
LED	Description										
● Green	Float (stage 3)										
● Orange	Charging (stage 1 or stage 2)										
● Red	The LED will present a constant red light when the abnormal status (OTP, OLP, fan fail and charging timeout) arises.										
● Red (Flashing)	The LED will flash with the red light when the internal temperature reaches 60°C; under this condition, the unit still operates normally without entering OTP. (In the meantime, an alarm signal will be sent out through the PMBus interface.)										

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 3KVAC/min I/P-FG :2KVAC/min O/P-FG:1.5KVAC/min	I/P-O/P: 3.6 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:1.8 KVAC/min Ta:25°C	I/P-O/P:6.77mA I/P-FG:7.63mA O/P-FG:5.84mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P: 30GΩ I/P-FG: 30GΩ O/P-FG: 30GΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	17 mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:230VAC/50HZ O/P:100% LOAD Ta:25°C	PASS
2	CONDUCTION	EN55022 CLASS B	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
3	RADIATION	EN55022 CLASS A	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 LIGHT INDUSTRY AIR : 8KV / Contact : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
5	E.F.T	EN61000-4-4 LIGHT INDUSTRY INPUT : 1KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
6	SURGE	IEC61000-4-5 LIGHT INDUSTRY L-N : 1KV L,N-PE : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare			

■ RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																																																				
1	TEMPERATURE RISE TEST	MODEL : RHB-8K1U-24 1. ROOM AMBIENT BURN-IN : 1 HRS I/P : 230VAC O/P : FULL LOAD Ta= 28.3 °C 2. HIGH AMBIENT BURN-IN : 3 HRS I/P : 230VAC O/P : FULL LOAD Ta= 52.5 °C																																																																																																																																						
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 28.3 °C</th> <th>HIGH AMBIENT Ta= 52.5 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>Q901</td><td>48.6°C</td><td>72.3°C</td></tr> <tr><td>2</td><td>Q904</td><td>75.5°C</td><td>81.5°C</td></tr> <tr><td>3</td><td>Q52</td><td>63.2°C</td><td>87.8°C</td></tr> <tr><td>4</td><td>D50</td><td>68.9°C</td><td>99.6°C</td></tr> <tr><td>5</td><td>BD1</td><td>58.1°C</td><td>85.6°C</td></tr> <tr><td>6</td><td>L900</td><td>45.9°C</td><td>68.6°C</td></tr> <tr><td>7</td><td>T3</td><td>37.6°C</td><td>61.7°C</td></tr> <tr><td>8</td><td>RG301</td><td>53.9°C</td><td>81.7°C</td></tr> <tr><td>9</td><td>RG302</td><td>51.7°C</td><td>76.2°C</td></tr> <tr><td>10</td><td>C302</td><td>30.3°C</td><td>55.3°C</td></tr> <tr><td>11</td><td>C355</td><td>38.1°C</td><td>59.4°C</td></tr> <tr><td>12</td><td>T1</td><td>30.2°C</td><td>76.1°C</td></tr> <tr><td>13</td><td>Q101</td><td>47.8°C</td><td>76.0°C</td></tr> <tr><td>14</td><td>Q104</td><td>48.7°C</td><td>77.2°C</td></tr> <tr><td>15</td><td>U921</td><td>41.9°C</td><td>70.4°C</td></tr> <tr><td>16</td><td>C5</td><td>38.4°C</td><td>64.2°C</td></tr> <tr><td>17</td><td>L100</td><td>65.7°C</td><td>97.8°C</td></tr> <tr><td>18</td><td>C980</td><td>33.4°C</td><td>63.9°C</td></tr> <tr><td>19</td><td>C11</td><td>42.8°C</td><td>69.2°C</td></tr> <tr><td>20</td><td>ZNR1</td><td>46.0°C</td><td>70.9°C</td></tr> <tr><td>21</td><td>ZNR2</td><td>42.3°C</td><td>75.6°C</td></tr> <tr><td>22</td><td>LF1</td><td>43.8°C</td><td>69.7°C</td></tr> <tr><td>23</td><td>C2</td><td>43.0°C</td><td>69.7°C</td></tr> <tr><td>24</td><td>D2</td><td>42.9°C</td><td>65.1°C</td></tr> <tr><td>25</td><td>L1</td><td>49.1°C</td><td>77.9°C</td></tr> <tr><td>26</td><td>L2</td><td>51.0°C</td><td>79.1°C</td></tr> <tr><td>27</td><td>RY1</td><td>45.3°C</td><td>71.4°C</td></tr> <tr><td>28</td><td>C101</td><td>47.0°C</td><td>73.6°C</td></tr> <tr><td>29</td><td>T52</td><td>37.9°C</td><td>65.3°C</td></tr> <tr><td>30</td><td>RTH21</td><td>54.0°C</td><td>76.4°C</td></tr> <tr><td>31</td><td>RTH9</td><td>45.3°C</td><td>72.3°C</td></tr> <tr><td>32</td><td>U671</td><td>43.8°C</td><td>70.0°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 28.3 °C	HIGH AMBIENT Ta= 52.5 °C	1	Q901	48.6°C	72.3°C	2	Q904	75.5°C	81.5°C	3	Q52	63.2°C	87.8°C	4	D50	68.9°C	99.6°C	5	BD1	58.1°C	85.6°C	6	L900	45.9°C	68.6°C	7	T3	37.6°C	61.7°C	8	RG301	53.9°C	81.7°C	9	RG302	51.7°C	76.2°C	10	C302	30.3°C	55.3°C	11	C355	38.1°C	59.4°C	12	T1	30.2°C	76.1°C	13	Q101	47.8°C	76.0°C	14	Q104	48.7°C	77.2°C	15	U921	41.9°C	70.4°C	16	C5	38.4°C	64.2°C	17	L100	65.7°C	97.8°C	18	C980	33.4°C	63.9°C	19	C11	42.8°C	69.2°C	20	ZNR1	46.0°C	70.9°C	21	ZNR2	42.3°C	75.6°C	22	LF1	43.8°C	69.7°C	23	C2	43.0°C	69.7°C	24	D2	42.9°C	65.1°C	25	L1	49.1°C	77.9°C	26	L2	51.0°C	79.1°C	27	RY1	45.3°C	71.4°C	28	C101	47.0°C	73.6°C	29	T52	37.9°C	65.3°C	30	RTH21	54.0°C	76.4°C	31	RTH9	45.3°C	72.3°C	32	U671	43.8°C	70.0°C
NO	Position	ROOM AMBIENT Ta= 28.3 °C	HIGH AMBIENT Ta= 52.5 °C																																																																																																																																					
1	Q901	48.6°C	72.3°C																																																																																																																																					
2	Q904	75.5°C	81.5°C																																																																																																																																					
3	Q52	63.2°C	87.8°C																																																																																																																																					
4	D50	68.9°C	99.6°C																																																																																																																																					
5	BD1	58.1°C	85.6°C																																																																																																																																					
6	L900	45.9°C	68.6°C																																																																																																																																					
7	T3	37.6°C	61.7°C																																																																																																																																					
8	RG301	53.9°C	81.7°C																																																																																																																																					
9	RG302	51.7°C	76.2°C																																																																																																																																					
10	C302	30.3°C	55.3°C																																																																																																																																					
11	C355	38.1°C	59.4°C																																																																																																																																					
12	T1	30.2°C	76.1°C																																																																																																																																					
13	Q101	47.8°C	76.0°C																																																																																																																																					
14	Q104	48.7°C	77.2°C																																																																																																																																					
15	U921	41.9°C	70.4°C																																																																																																																																					
16	C5	38.4°C	64.2°C																																																																																																																																					
17	L100	65.7°C	97.8°C																																																																																																																																					
18	C980	33.4°C	63.9°C																																																																																																																																					
19	C11	42.8°C	69.2°C																																																																																																																																					
20	ZNR1	46.0°C	70.9°C																																																																																																																																					
21	ZNR2	42.3°C	75.6°C																																																																																																																																					
22	LF1	43.8°C	69.7°C																																																																																																																																					
23	C2	43.0°C	69.7°C																																																																																																																																					
24	D2	42.9°C	65.1°C																																																																																																																																					
25	L1	49.1°C	77.9°C																																																																																																																																					
26	L2	51.0°C	79.1°C																																																																																																																																					
27	RY1	45.3°C	71.4°C																																																																																																																																					
28	C101	47.0°C	73.6°C																																																																																																																																					
29	T52	37.9°C	65.3°C																																																																																																																																					
30	RTH21	54.0°C	76.4°C																																																																																																																																					
31	RTH9	45.3°C	72.3°C																																																																																																																																					
32	U671	43.8°C	70.0°C																																																																																																																																					
2	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 230VAC/180VAC O/P : 100 % LOAD Ta= -35°C / -30°C	TEST : OK																																																																																																																																				
3	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C NO DAMAGE	I/P : 272 VAC O/P : FULL LOAD Ta= 50 °C HUMIDITY= 95%R.H	TEST : OK																																																																																																																																				



4	TEMPERATURE COEFFICIENT	$\pm 0.03 \% / ^\circ\text{C}$ (0-50°C)	I/P : 230 VAC O/P : FULL LOAD	$\pm 0.005 \% / ^\circ\text{C}$ (0-50°C)
5	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -45°C ~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC		OK
6	THERMAL SHOCK TEST	1. Thermal shock Temperature : -35°C ~ +55°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 15cycle:230V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST(13500 TIMES) 1cycle:230V/ FULL LOAD Burn In Test		OK
7	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 12min/sweep cycle (4) Acceleration : 2G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C		TEST : OK
8	CAPACITOR LIFE CYCLE	SUPPOSE C101 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta= 25°C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta= 50°C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 50°C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 50°C LIFE TIME		(1) 781466HRS (2) 119480HRS (3) 179758HRS (4) 222934HRS
9	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure (Expected Life): Above 50,000 hours @ TA 50°C		

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	DANIEL GAO	SANFORD SU	VINCENT TSENG

12.10.30 A50-F031